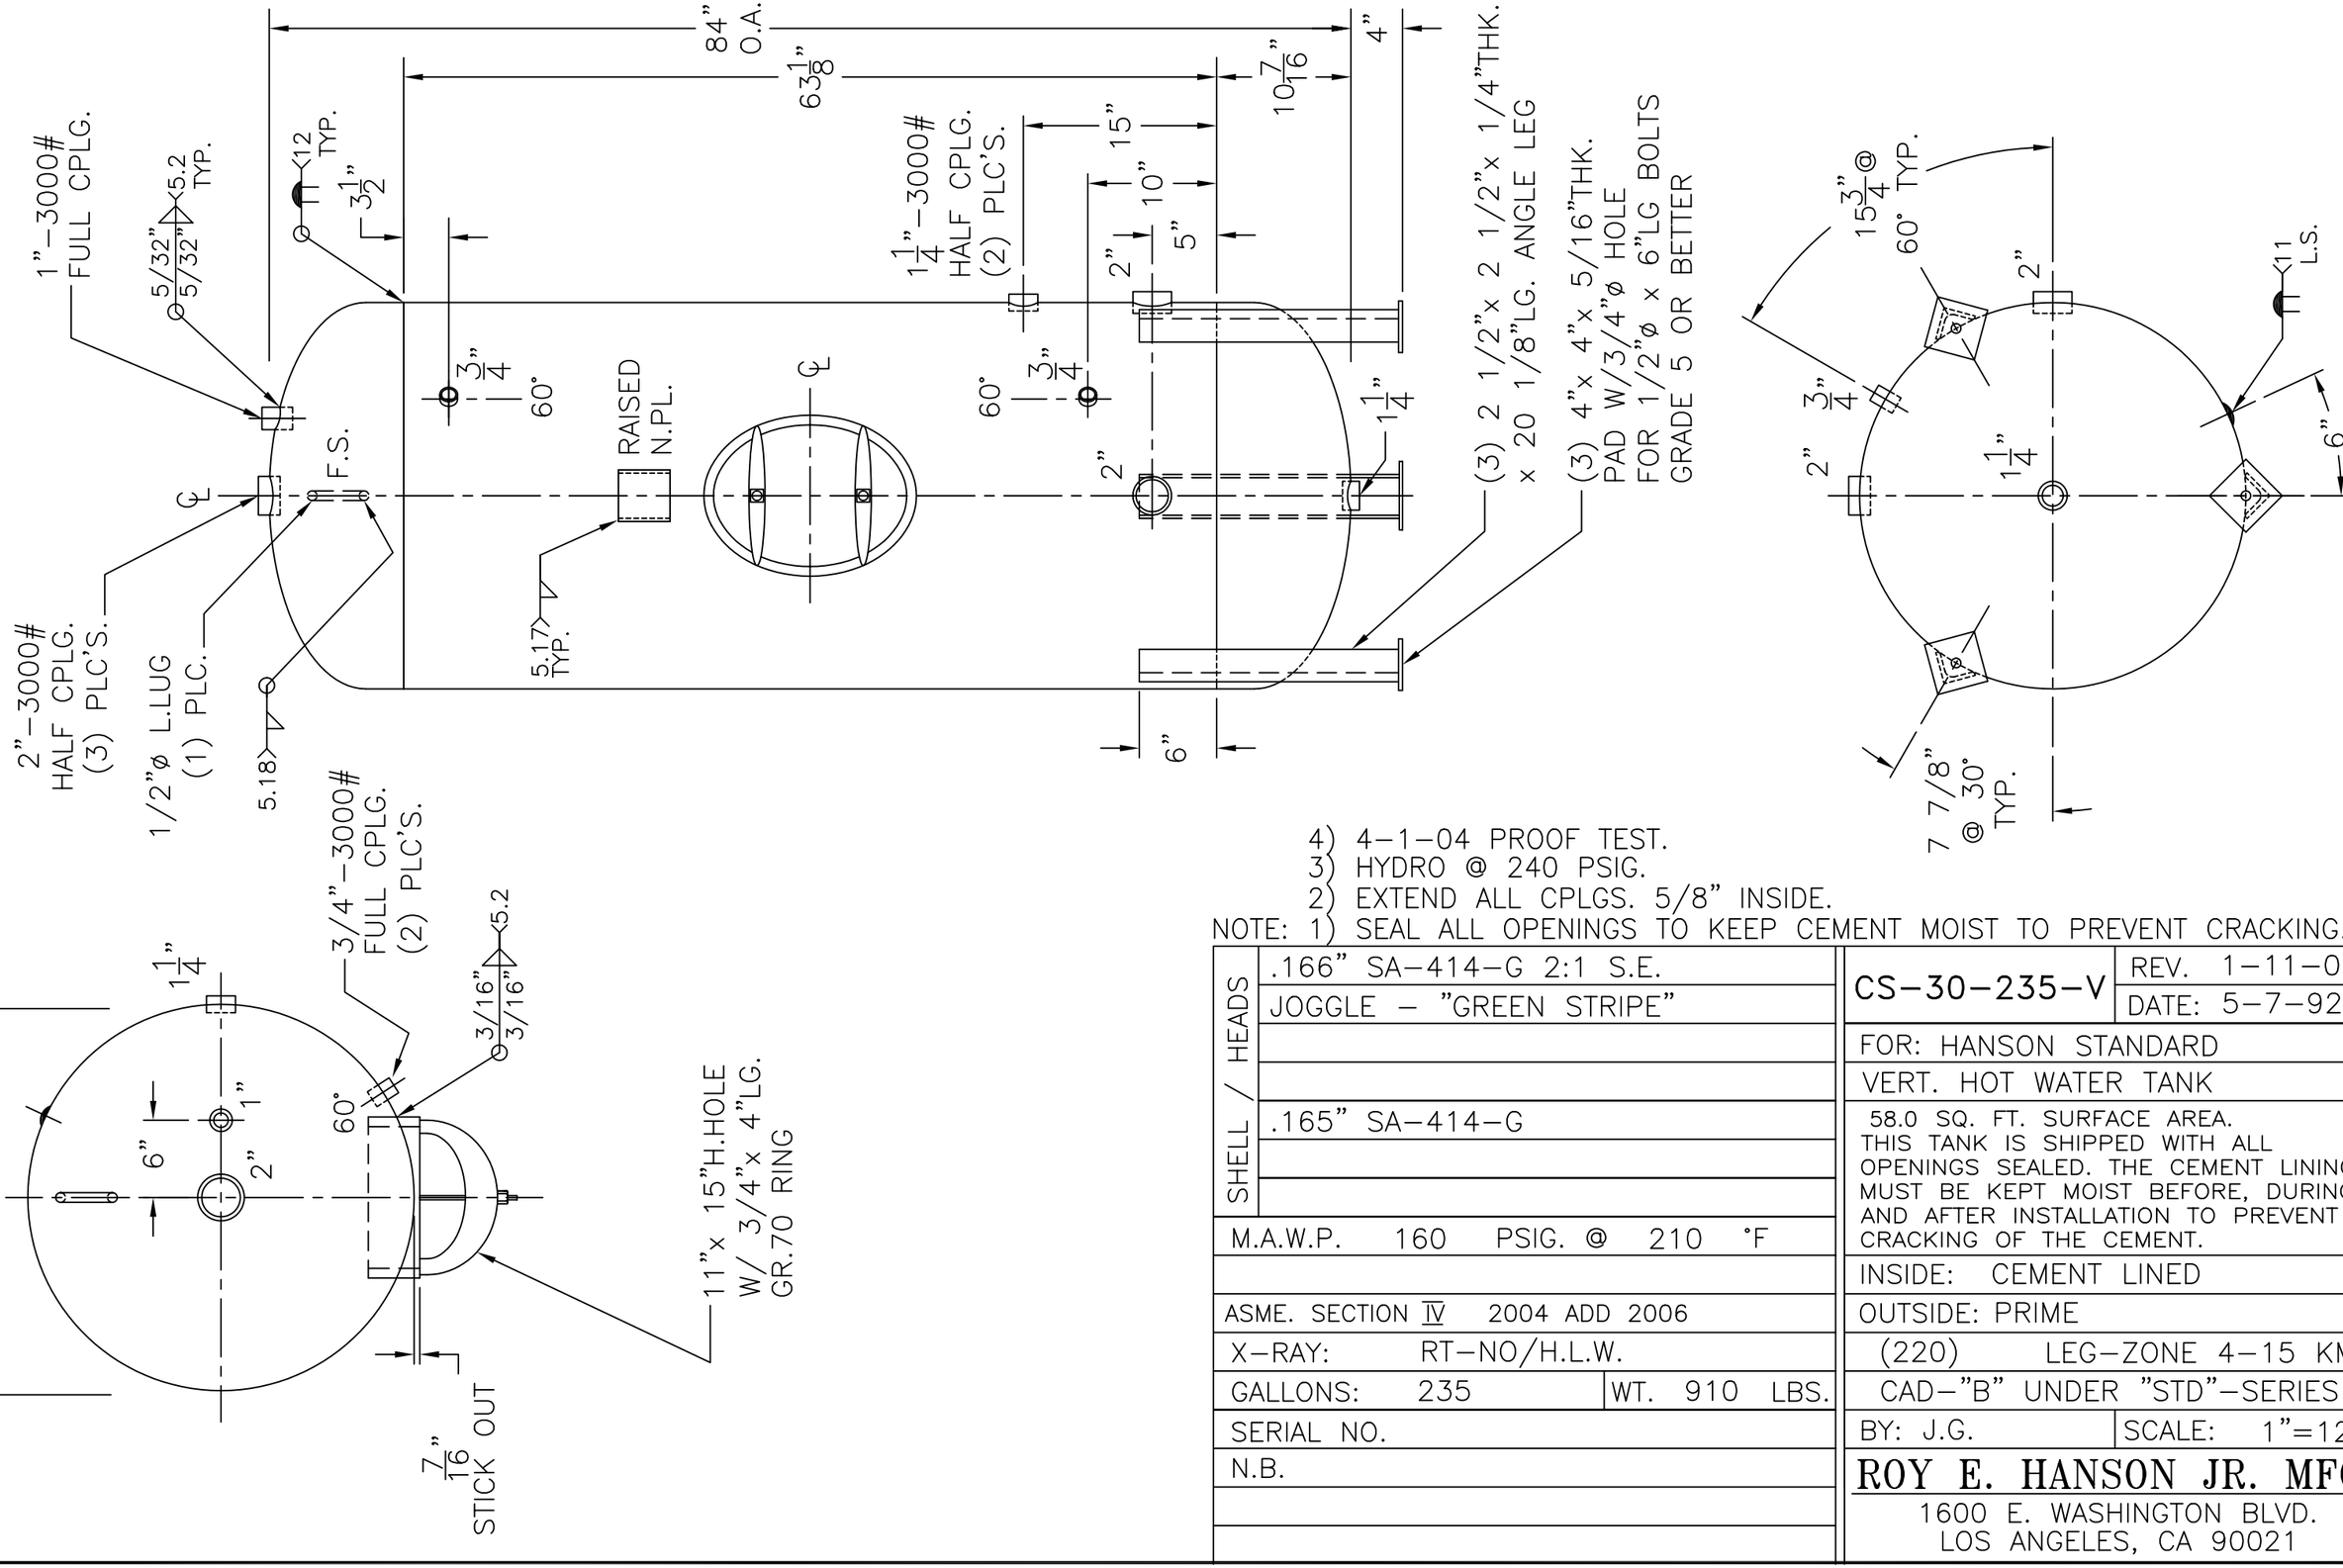

4) 4–1–04 PROOF TEST.
3) HYDRO @ 240 PSIG.
2) EXTEND ALL CPLGS. 5/8" INSIDE.
NOTE: 1) SEAL ALL OPENINGS TO KEEP CEMENT MOIST TO PREVENT CRACKING.

SHELL / HEADS	.166" SA–414–G 2:1 S.E.	CS–30–235–V	REV. 1–11–07
	JOGGLE – "GREEN STRIPE"		DATE: 5–7–92
		FOR: HANSON STANDARD	
		VERT. HOT WATER TANK	
	.165" SA–414–G	58.0 SQ. FT. SURFACE AREA. THIS TANK IS SHIPPED WITH ALL OPENINGS SEALED. THE CEMENT LINING MUST BE KEPT MOIST BEFORE, DURING, AND AFTER INSTALLATION TO PREVENT CRACKING OF THE CEMENT.	
M.A.W.P. 160 PSIG. @ 210 °F		INSIDE: CEMENT LINED	
ASME. SECTION IV 2004 ADD 2006		OUTSIDE: PRIME	
X–RAY: RT–NO/H.L.W.		(220) LEG–ZONE 4–15 KM.	
GALLONS: 235	WT. 910 LBS.	CAD–"B" UNDER "STD"–SERIES	
SERIAL NO.		BY: J.G.	SCALE: 1"=12"
N.B.		ROY E. HANSON JR. MFG. 1600 E. WASHINGTON BLVD. LOS ANGELES, CA 90021	